

Installation Instructions

NSEM-6ND

Enclosure without Emergency Battery for 6" Surface Mounts

READ PRIOR TO ATTEMPTING INSTALLATION
ALWAYS TURN OFF MAIN POWER BEFORE INSTALLATION
INSTALLATION SHOULD BE CARRIED OUT BY YOUR LOCAL ELECTRICIAN

⚠ IMPORTANT - This equipment is intended to be installed only by qualified personnel. The installation must be made in accordance with the current edition to the National Electric Code and all applicable state and local building codes. The final installation must be approved by the appropriate qualified electrical/building inspector(s). Improper installation may result in a fire or electrical hazard. Be sure the electrical power to the circuit has been disconnected before installing this electrical system.

⚠ IMPORTANT - Cet équipement est destiné à être installé uniquement par du personnel qualifié. L'installation doit être faite en conformité avec l'édition actuelle du Code national de l'électricité et toutes étatiques et locales codes du bâtiment applicables. L'installation finale doit être approuvée par l'inspecteur en électricité / bâtiment qualifié approprié(s). Une mauvaise installation peut entraîner un incendie ou un risque électrique. Soyez sûr de la puissance électrique vers le circuit a été coupée avant l'installation de ce système électrique.

IMPORTANT SAFEGUARDS


READ AND FOLLOW ALL SAFETY INSTRUCTIONS

When using electrical equipment, basic safety precautions should always be followed, including the following:

1. Disconnect power at fuse or circuit breaker before installing or servicing.
2. Do not use outdoors.
3. Do not mount in hazardous locations or near gas or electric heaters.
4. Do not let power cords touch hot surface.
5. Equipment should be mounted in locations and at heights where it will not be subjected to tampering by unauthorized personnel.
6. The use of accessory equipment not recommended by the manufacturer may cause an unsafe condition.
7. Do not use this equipment for purposes other than its intended use.
8. All servicing should be performed by qualified personnel only.




PACKAGING CONTENTS




Enclosure without
Emergency Battery



(2) M4 Machine Screws
0.2" Long




(2) 8-32 Machine Screws
1" Long




(5) Wire Nuts


COMPATIBLE JUNCTION BOXES




3" Octagonal Junction Box




4" Octagonal Junction Box
Metallic or Non- Metallic
(Carlson A615)




4" Round Non-Metallic
(Carlson B620)



4" Pancake Junction Box



4" Square Junction Box



4" Round Non-Metallic
(Carlson B618R)

Installation Instructions


NSEM-6ND

Enclosure without Emergency Battery for 6" Surface Mounts

READ PRIOR TO ATTEMPTING INSTALLATION
ALWAYS TURN OFF MAIN POWER BEFORE INSTALLATION
INSTALLATION SHOULD BE CARRIED OUT BY YOUR LOCAL ELECTRICIAN


INSTALLATION INSTRUCTIONS

- 1** Remove the appropriate junction box labels and install the empty enclosure to the junction box by two screws (provided), securing it through the appropriate mounting holes.

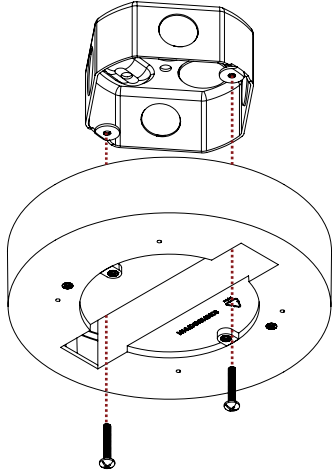

NOTE: MOUNTING HOLES ARE LABELED FOR USE WITH COMPATIBLE JUNCTION BOXES.
NOTE: DO NOT OVER TORQUE SCREWS. OVER TORQUING SCREWS WILL DEFORM UNIT.
NOTE: NSEM-6ND DOES NOT INCLUDE EMERGENCY LED DRIVER.

- 2** After securing the empty enclosure to the junction box. Connect the luminaire to the supply leads. Secure the luminaire to the empty enclosure through the designated mounting holes on the emergency unit to complete installation.

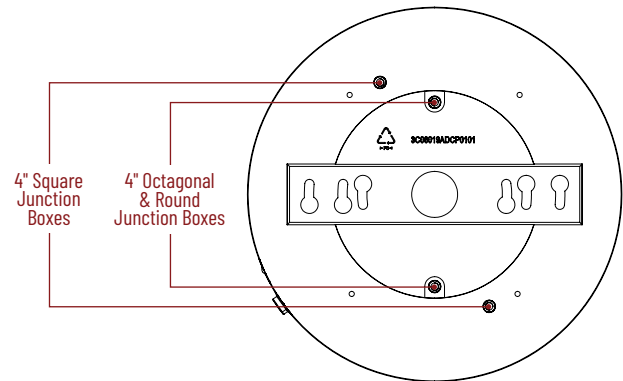

NOTE: DO NOT OVER TORQUE SCREWS. OVER TORQUING SCREWS WILL DEFORM UNIT.
NOTE: USE M4*0.2" SCREW FOR LUMINAIRE INSTALLATION.